




WARNING
DISCONNECT POWER
BEFORE WORKING
WITHIN

GENERAL
SWITCH



CONTROL
THERMOSTAT

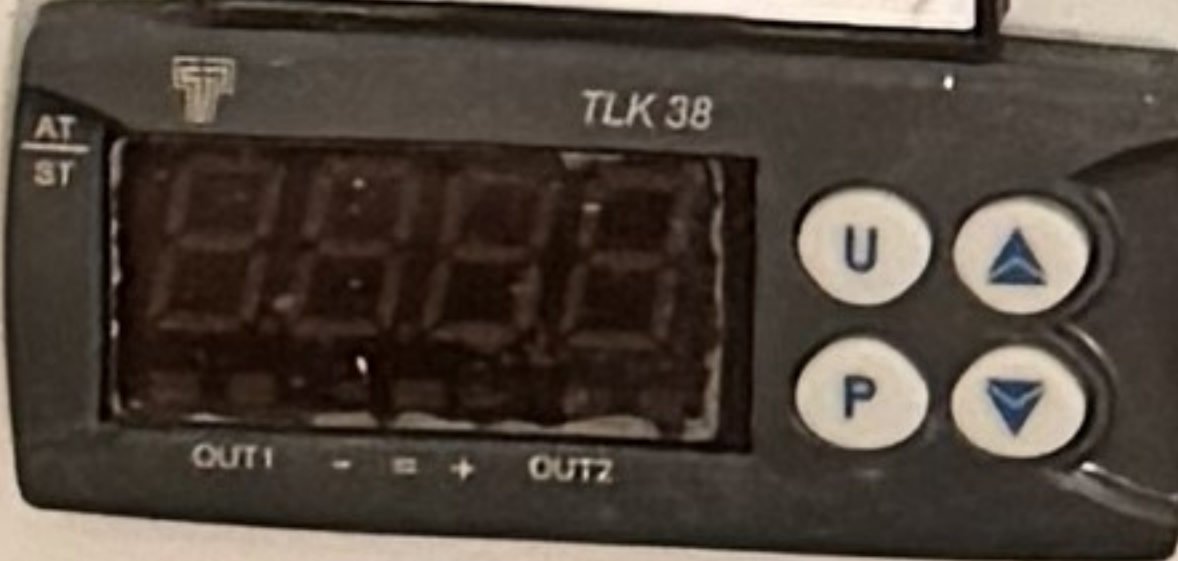

COMPRESSOR
0 1




AGITATOR
0 1



BLOCK
0 1



GEWISS
GW 44 810
IP65 CE



 **CRIVELLER**
COMPANY
NIAGARA FALLS

WORTHINGTON
PRO GRADE


PROPANE TANK
BOTTLE DE PROPANE





**CE CONFORME AU
CODE DU TRAVAIL**

**NOM DU
CONSTRUCTEUR**

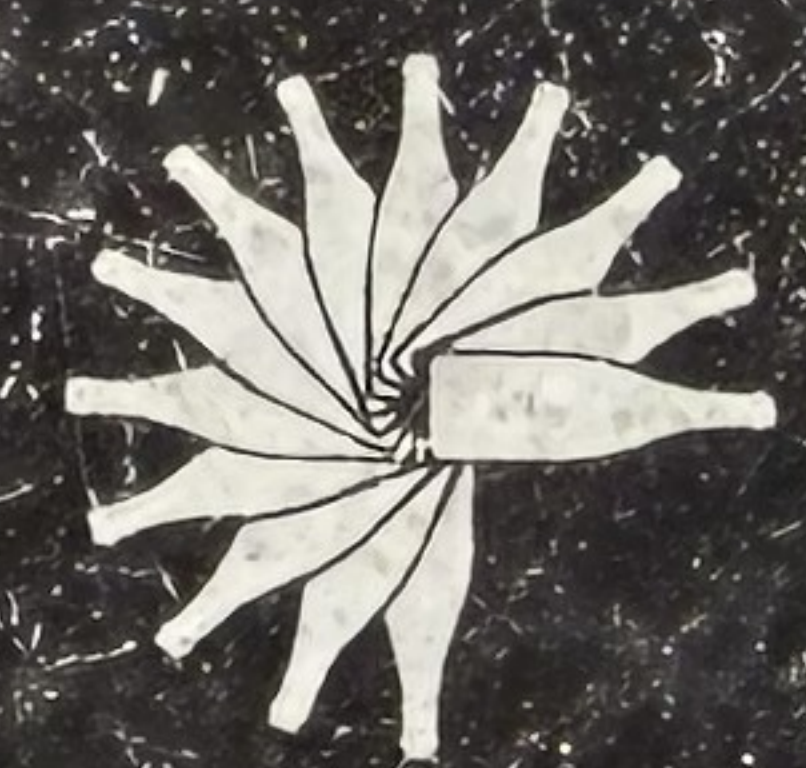

PETITDEMANGE SARL
ZONE INDUSTRIELLE
68126 BENNWIHR GARE / FRANCE

**ANNEE DE
CONSTRUCTION**

1998

TYPE

REMUPAL

No DE SERIE

84

